



# Resetting A Fire/Shield Damper (from Non-Access Side)

Step 2

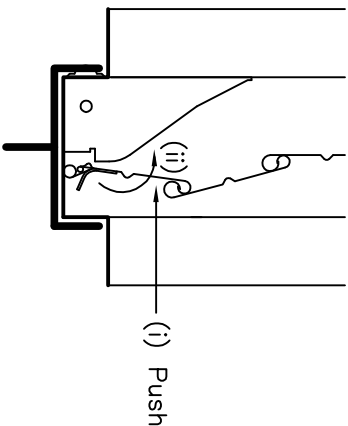


(i) Push top of bottom blade to clear locking ramp as shown, (ii) allowing gap to slide hand under.

Step 3

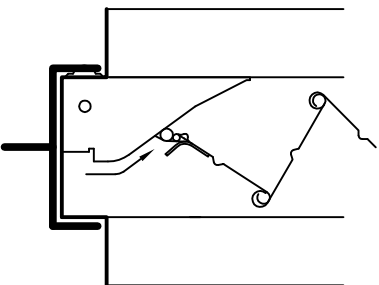


Lift bottom blade up and forward to follow the locking ramp profile.

Step 4

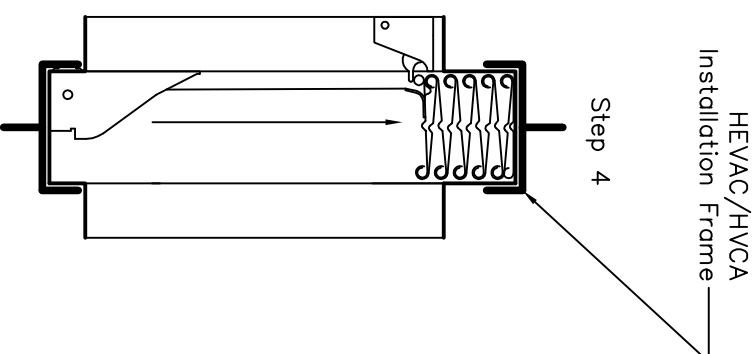

Raise bottom blade until it locks with cassette.

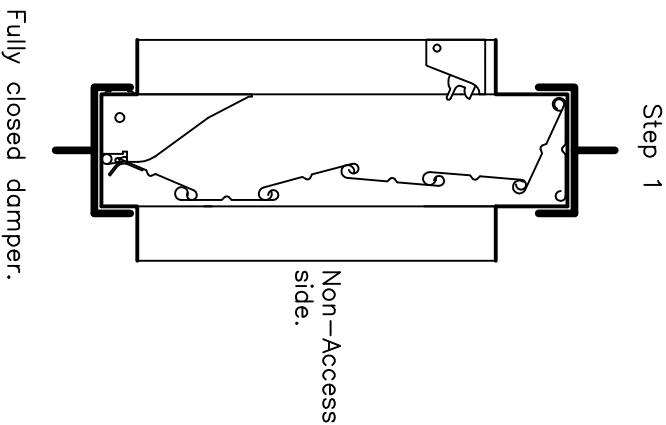

**NOTES**

**Important**

Ensure that the bottom blade is perpendicular to the travel of the blade pack. If this does not happen or if the bottom blade is folded back on itself it may damage the closing springs with a permanent kink, the result of which would be detrimental to the future operation of the fire damper.

**actionair**  
 © RUSKIN AIR MANAGEMENT LIMITED  
 South Street, Whitstable  
 Kent CT5 3DU  
 Telephone: 01227 276100  
 Facsimile: 01227 264262  
 www.actionair.co.uk

Rev	Change	Dates
A	Update Visual Indicator	25/03/03
	Drawn By S.C.	25/03/03
	Checked By P.C.C.	31/03/03
	Approved By M.B.	25/03/03
Customer		
Project		
Title <b>Resetting a Fire/Shield From Non-Access Side</b>		
Drawing No.	Revision	
<b>AAF/9251</b>	<b>A</b>	

This drawing is confidential communication and is the property of Ruskin Air Management Limited and is returnable on request. It is not to be copied, loaned or communicated without the consent of Ruskin Air Management Limited. This drawing should be considered uncontrolled if it is a printed copy, or has been transmitted outside of Ruskin Air Management Limited, electronically. The live version is the electronic copy held at Ruskin Air Management Ltd. Please confirm the drawing issue before placing any orders which refer to this drawing.