

ADAPT™ Extract

Extract air diffuser for the WISE system



ADAPT Extract

Quick facts

- ▶ Active damper
- ▶ Pressure-dependent and cleanable
- ▶ Integrated sensor module
- ▶ Simple wiring, Plug & Play
- ▶ Communication via Modbus RTU
- ▶ Supplied complete with junction box (master)
- ▶ Complemented with the WISE templates, containing detailed descriptions for planning
- ▶ Allows for control of (When used as master):
 - Heat alternatively, cooling valve (max. 3 actuators per master)
 - Slaves (supply or extract air, 3 pcs)
 - Lighting (via relay)

Quick Selection

AIR FLOW – SOUND LEVEL			
Size	min q ^{*)} (l/s)	max q (l/s)	
		50 Pa / 30 dB(A)	80 Pa / 35 dB(A)
200	0/5	50	85
250	0/10	65	100

^{*)} The first value indicates closed damper, the second value indicates lowest adjustable air flow.

Technical Description

Design

ADAPT is a series of flow-controlled supply air diffusers for the Swegon WISE system:

- The air diffuser controls the airflow with an active damper inside the commissioning box, see figure 1.
- An ADAPT diffuser is always supplied with a commissioning box.
- Inside the air diffuser, is a controller providing all the required set points and control functions as well as a multi-functional sensor module, see figure 1.

Functions in the Master diffuser

- Cools/heats and ventilates with air.
- Two stage cooling with water in the second stage, cannot be combined with heating.
- Controls airflow with regard to temperature and presence.
- Ventilation boost after longer periods of unoccupancy.
- Provision for wiring to a CO₂ controller.
- Provision for manually setting set points.
- Has provision for connection to a main control system (Modbus).
- Emergency functions for closing / opening of the damper.
- Control of the heating in sequence unless 2-stage cooling has been selected.
- Indication via LED. Indicates current operating mode and warns of malfunctions in the diffuser.
- Comfort control indicated by the LED if the room temperature or CO₂ value deviates too much from the set point, not activated by default.

Sensor module

A sensor module is integrated in all ADAPT supply air diffusers, containing the following functions:

- A temperature sensor controls the airflow to maintain required temperature in the room.
- A presence detector makes it possible to save additional energy by lowering the airflow when there are no occupants in the room.
- The presence signal from the air diffuser can be fetched for controlling the lighting, for instance, and in this way save more energy.

Connectivity

In each delivery of a master diffuser, a CONNECT Adapt junction box is included:

- The junction box replaces the coupling box which otherwise is mounted on a wall/ceiling for wiring a 24 V supply voltage to the air diffuser and Modbus networks.
- Both air diffuser and junction box are equipped with RJ45 quick-fit connectors for quick and fault-free wiring.
- The device has provision for connection to a main control system (BMS/SCADA) via ModBus.
- Accessory cable, LINK Modbus (RJ12) can be connected between air diffuser and junction box. The air diffuser will then be ready for the main control system.
- From the junction box, control functions for heating in sequence, CO₂ sensor and set point adjuster, can also be connected.



Planning – WISE Templates

See separate documentation, "WISE Project manual", available for download from www.swegon.se.

In addition, Swegon sales personnel can supply WISE templates containing descriptions with detailed information regarding functionality, flowcharts, wiring diagrams and demarcation list for various constructions.

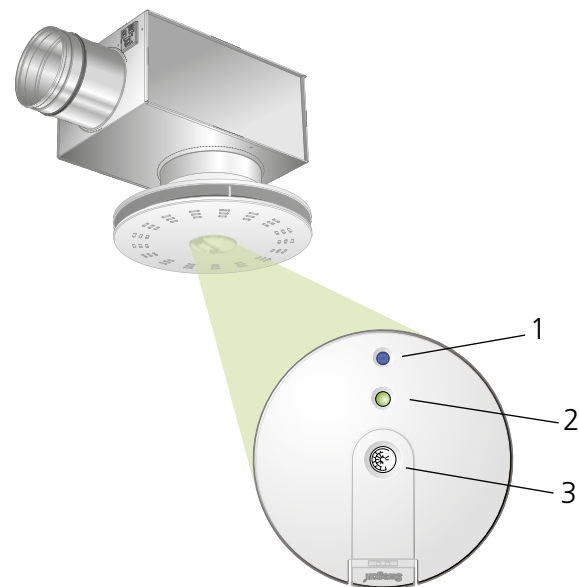


Figure 1. The sensor module of ADAPT Extract with connection for TUNE Adapt.

1. Temperature detector
2. In-operation indicator, green, red and orange LED.
3. Presence detector

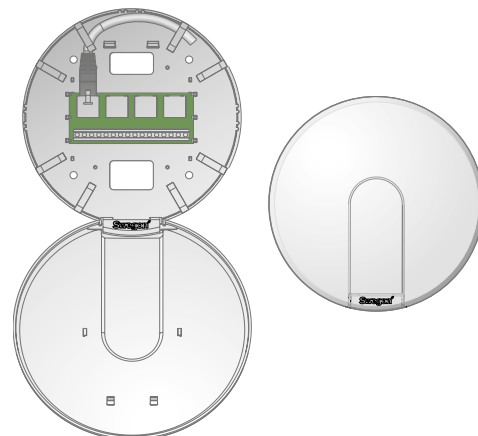


Figure 2. Junction box, CONNECT Adapt.

Installation

A detailed installation instruction is enclosed with each delivery and can also be downloaded from www.swegon.com.

1. The commissioning box can be suspended from a ceiling and connected to duct system. Use hanger system A or B.
2. Press the ADAPT Extract air diffuser into the outlet of the commissioning box and secure it with screws or pop rivets. Readjust the hanger rods of the commissioning box if needed, so that the air diffuser sits tight against the ceiling, or the modular suspended ceiling.

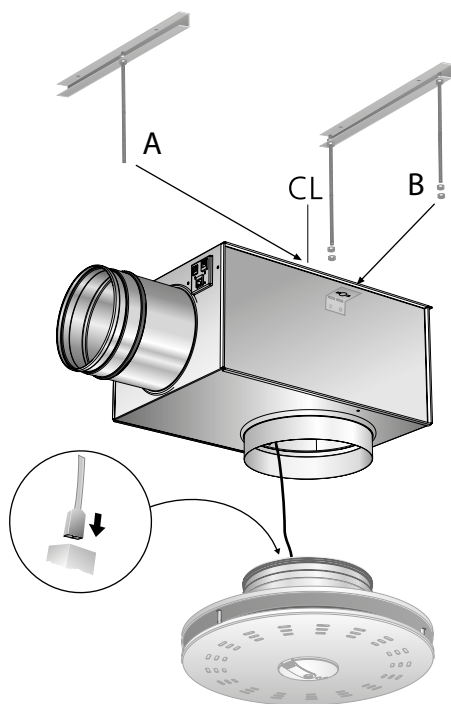


Figure 3. ADAPT Extract, installation.

Commissioning

- Normally, the ADAPT air terminals are preset from the factory based on design values.
- The TUNE Adapt hand-held terminal is used for manually checking the current air flow through the air diffuser, and for changing set points, if required.
- For more information, see the installation - Commissioning - Maintenance instruction as well as the TUNE Adapt user manual.

Materials and finish

- ADAPT air terminals are made of galvanized sheet steel, with parts made of plastic, rubber and also contain electronic components.
- The ADAPT air terminals are powder coated in Swegon's white interior standard colour RAL 9010, both on the inside and on the outside.
- The sensor module and junction box are made of ABS plastic.
- The commissioning box is made of galvanized sheet steel with internal insulation.

Maintenance

- The ADAPT air terminals can be cleaned on the outside, if necessary, using lukewarm water with dish-washing detergent added.
- The duct system is accessible without need for tools. (See the separate installation instruction)

Declaration

Declaration of Construction Materials is available for download from www.swegon.com.

Electrical data

ADAPT is supplied with power via the junction box.

For more information about various wiring and room solutions, see the Technical Section.

Supply voltage	24 V AC $\pm 10\%$
Max. power consumption	3 VA
Cable rating	0,6 A
Ambient temperature	0 °C - +50 °C

Forms of delivery

- Some of the ADAPT-products are available from stock with standard settings.
- At delivery, a master air diffuser contains a complete air diffuser with commissioning box, junction box CONNECT Adapt and 5 metre long RJ45 cable LINK Adapt.
- Delivery of a slave air diffuser contains a complete air diffuser with commissioning box and 5 metre long RJ45

Standard settings

Temperatures (°C)

Presence	22	± 1 K
Absence	22	+3 / -2 K
Night-time cooling	18	
Morning heat	25	

Airflows (l/s)

	Absence	Min. airflow	Max. airflow
The smallest size	0/5	10	60
The largest size	0/10	15	90

Air quality (ppm)

	Min.	Max.
CO ₂	800	1000

Presence

Switch on delay	0 sec.
Switch out delay	20 min.

Communication Modbus RTU by RS-485

Modbus ID	1
Speed	38,400 bps
Bit length	8 bits
Stop bits	1 bit
Parity	None

Sizing

- The specified sound levels dB(A) are applicable to rooms with an equivalent sound absorption area of 10 m² (4 dB room attenuation).
- For calculating the air stream propagation, air velocities in the occupancy zone, or sound levels in rooms with other dimensions, we refer to our ProAir Web calculation program. ProAir Web is available at www.swegon.com.

Sound data

Sound power level, L_w (dB)

Table, K_{ok}

Size	Mid-frequency (Octave band) Hz							
	63	125	250	500	1000	2000	4000	8000
200	-1	16	7	-2	-7	-17	-21	-19
250	4	15	8	-2	-7	-16	-23	-22
Tol. \pm	2	2	2	2	2	2	2	2

Sound attenuation ΔL

Table ΔL


Size	Mid-frequency (Octave band) Hz							
	63	125	250	500	1000	2000	4000	8000
200	18	11	13	20	19	17	20	18
250	13	6	12	21	18	18	21	19
Tol. \pm	2	2	2	2	2	2	2	2

Engineering graphs


Air flow – Pressure drop – Sound level

- The diagrams should not be used for commissioning.
- The dB(C) value is normally 6-9 dB higher than the dB(A) value.
- Sizing example – size 200:
 - Given airflow 10-50 l/s at P_t 50 Pa.
 - Max. sound level 28 dB(A)

ADAPT Extract 200

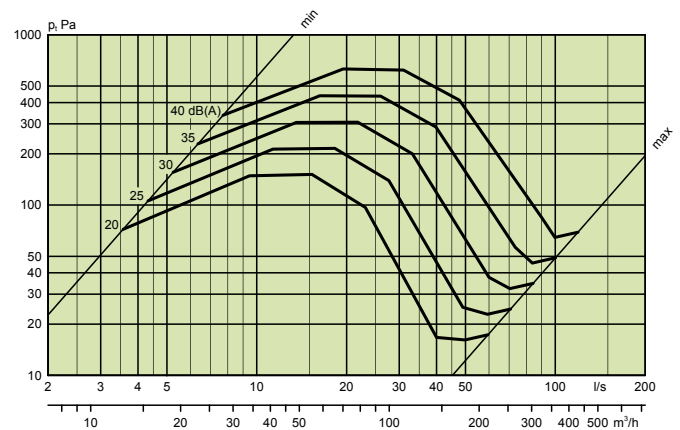

ADAPT Extract 250

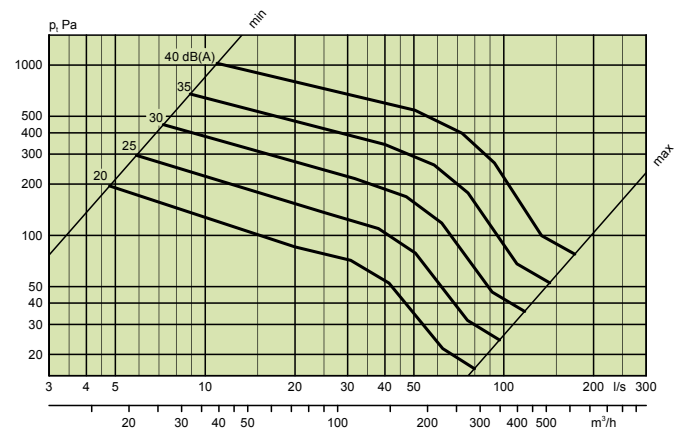

Dimensions and weights

ADAPT Extract

Size	Dimensions (mm)					
	A	B	C	ØD	Ød	E
200	456	504	332	199	250	345
250	568	622	388	249	315	425

Size	Dimensions (mm)						Weight (kg)
	F	G	H	I	ØJ	K	
200	240	216	465	55	350	115	8,2
250	300	267	575	55	450	140	12,4

ØJ = Cutting hole size

CL = Center line

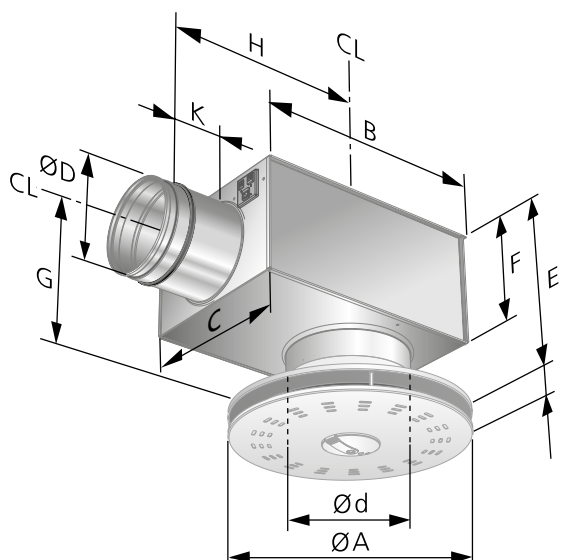


Figure 4. ADAPT Extract, dimension figure.

Ordering key

Product

Circular active air diffuser for ceiling ADAPT E c -bbb -c

Version:

Connection dimensions:

M: Master, S: Slave

N.B.! Specify absence, min./max. airflows in your specification!

Standard range:

Size: 200, 250

Accessories

DETECT Quality	Temperature and CO ₂ sensor with set point selector knob
TUNE Adapt	Hand-held terminal for reading/changing settings
TUNE Temp	Temperature adjuster
LINK Modbus	RJ12-cable for connecting up Modbus RTU
LINK Adapt	RJ45 cable for connecting up in other lengths
SPLIT Link	Split connector
FIX Link	For securing cords to ducts, etc.
POWER Adapt	Transformer
ACTUATOR	Valve actuator, on/off
VALVE	Radiator valve
ADAPT Relay	Relay for light or heat control
ADAPT TR	Semi-conductor relay for lighting or heat control
CABLE Ext	Extension cable between box and air diffuser
LINK Wa	Network cable for Modbus, complies with the EIA-485 standard